


OPTION 1

OPTION 2

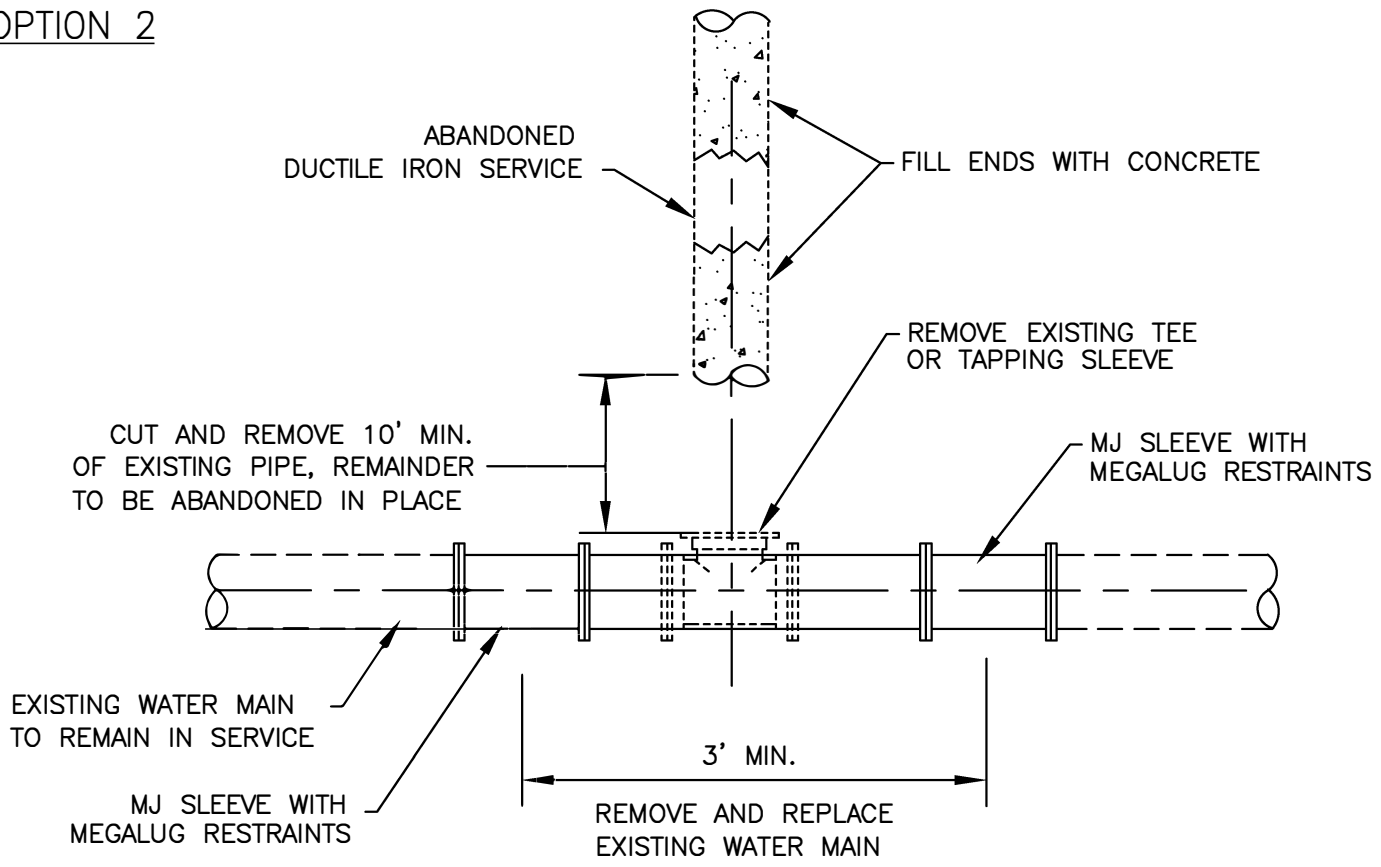

NOT TO SCALE

NOTES:

1. IF EXISTING SERVICE TEE CANNOT BE PROPERLY CAPPED AS SHOWN IN OPTION 1, TEE WILL BE REMOVED AND WATER MAIN REPLACED AS INDICATED BY OPTION 2.

CITY OF JOLIET, ILLINOIS

WATER SERVICE ABANDONMENT  
DUCTILE IRON PIPE  
DETAIL  
WTR-14  
DATE: NOVEMBER 2022